



PLAN VIEW

CHAMBER		Volume (gal)
①	Sedimentation Chamber	277
②	Anaerobic Filtration Chamber	278
③	Aerobic Contact Filtration Chamber	127
④	Storage Chamber	63
⑤	Disinfection Chamber	4
Total Volume		749

SPECIFICATIONS			
Anaerobic Media	PP / PE	Filling Rate	32%
Board Type Aerobic Media	PVC / PP / PE	Filling Rate	16%
Aerobic Media	PP / PE	Filling Rate	57%
Blower	2.8 cfm		
Tank	FRP		
Piping	PVC / PP / PE		
Access Covers	Plastic / Cast Iron		
Disinfectant (Optional)	Chlorine Tablets		

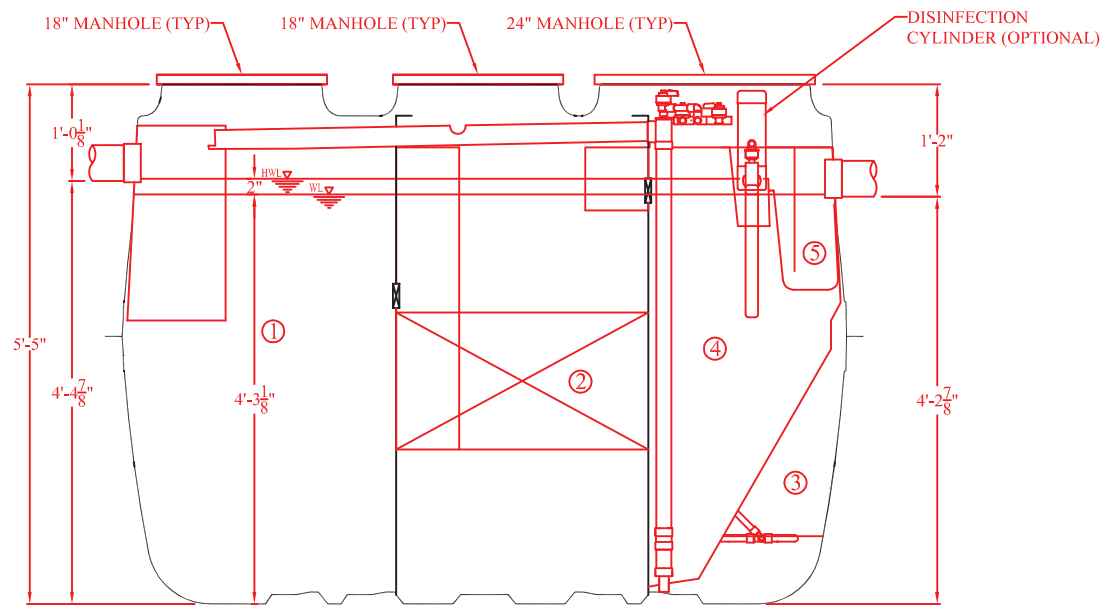

SECTION A-A VIEW

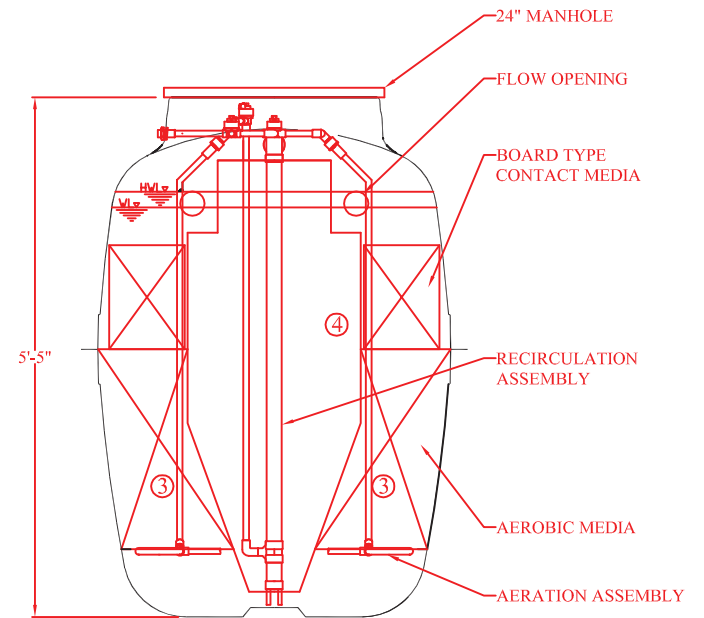

SECTION B-B VIEW



CEN-5
Structural Drawing

DATE: 07/01/2014 SCALE: 1/2" = 1"